


Installation of Optional Equipment

BACK DRAFT DAMPER

OPTIONAL ACCESSORY PART # AM-BD10 & AM-BD12 Back Draft Damper

The Back Draft Damper may be installed in either a vertical or horizontal section of the 12" round hot air duct. It should be positioned as close to the plenum opening of the Shelter Furnace as practical. Press the female end of the damper over the Shelter Furnace collar or male end of the duct pipe. When properly positioned, the arrows on the air flow decal point "away" from the Shelter Furnace.

NOTE: The back draft damper may cause the blower to cycle on and off frequently. If this occurs, install a sheet metal screw inside of the damper to prevent the flapper from closing completely. This will allow heat to rise off of the furnace.

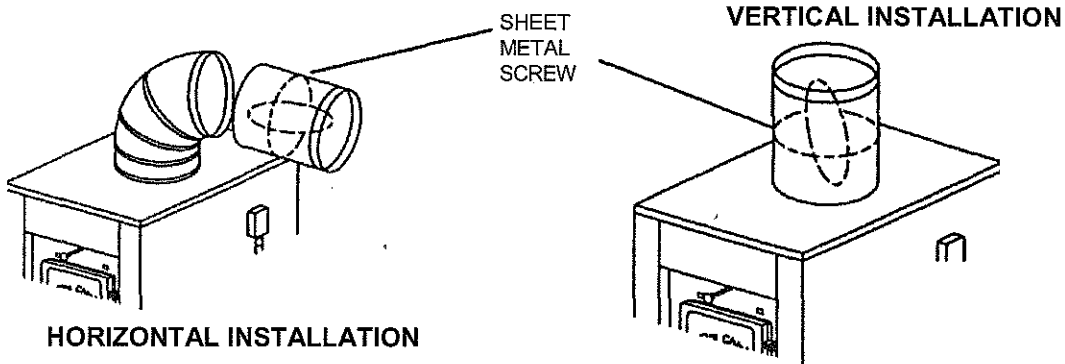

HORIZONTAL INSTALLATION

NOTE: Position so that air flow will open damper in the direction of ductwork

VERTICAL INSTALLATION

NOTE: Position so that air flow will open damper from bottom.